

Configuring Device Parameters

Navigation

This can be accessed via the [Device Dashboard](#) page.


Overview

On this page, device parameter information is displayed and can be interacted with. This page is split up into 3 tabs, namely:

1. The Overview Tab
2. The View Tab
3. The Edit Tab


The Overview Tab

On this page, device parameter information can be viewed and interacted with.

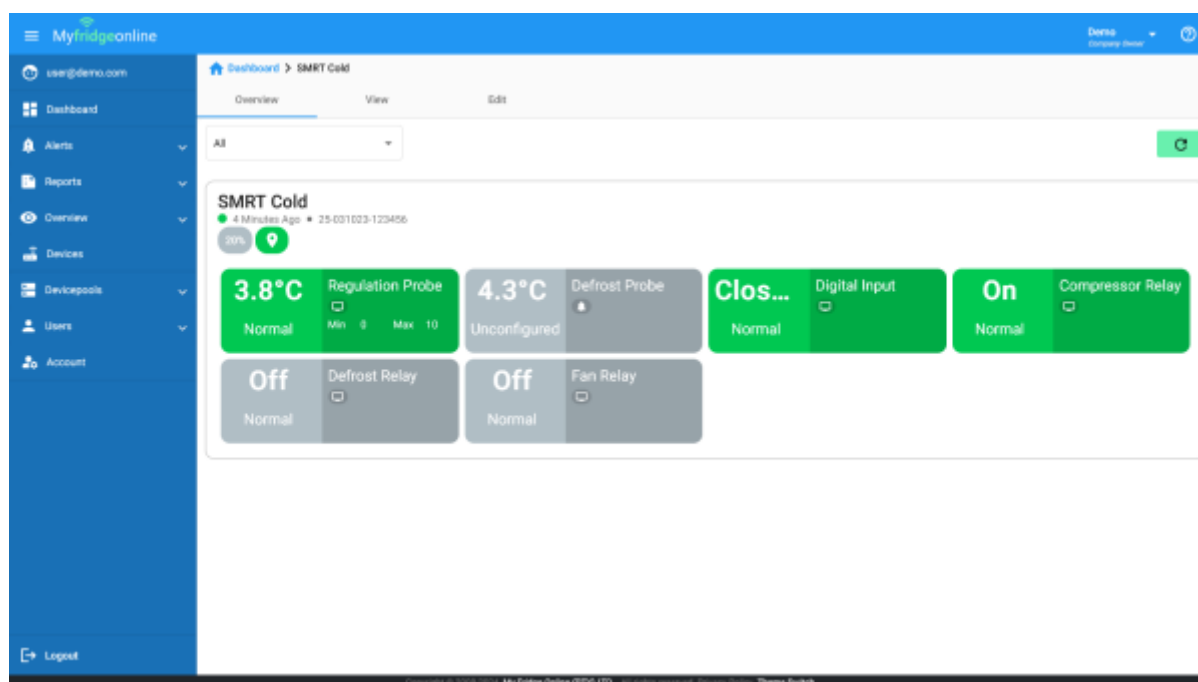


Filtering Parameters

Parameters can be filtered by their status by using the drop down menu. The search function also allows further filtering.

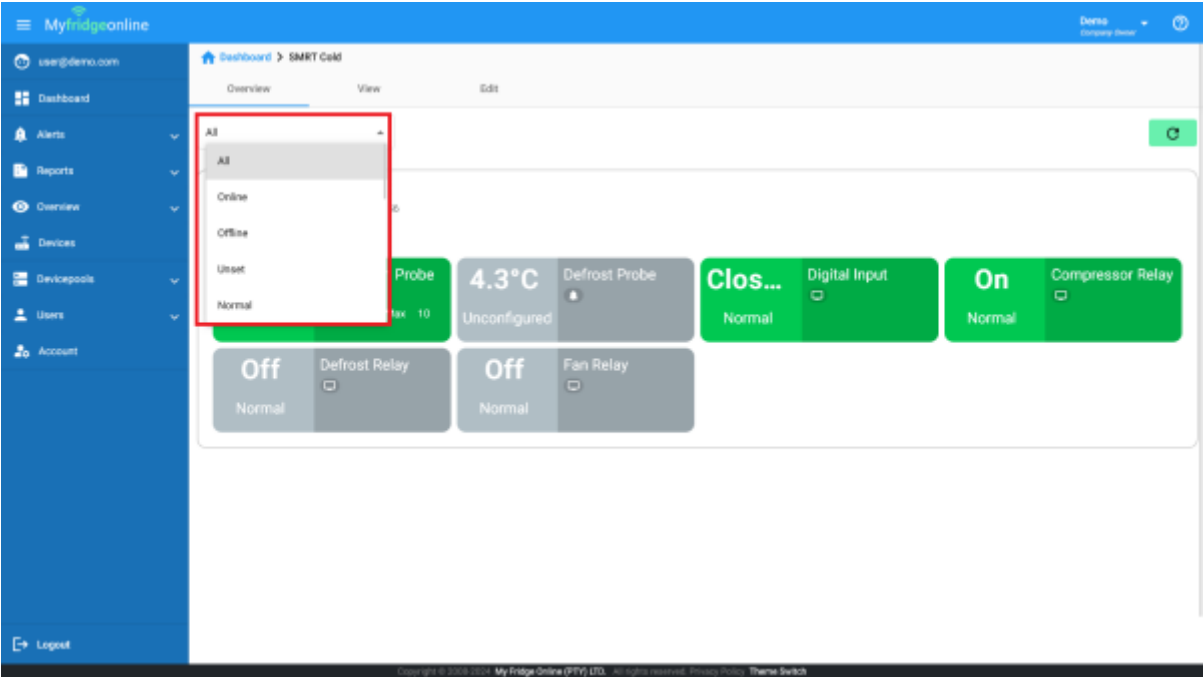


Last Synced Time

The device's last synced time can be viewed here.

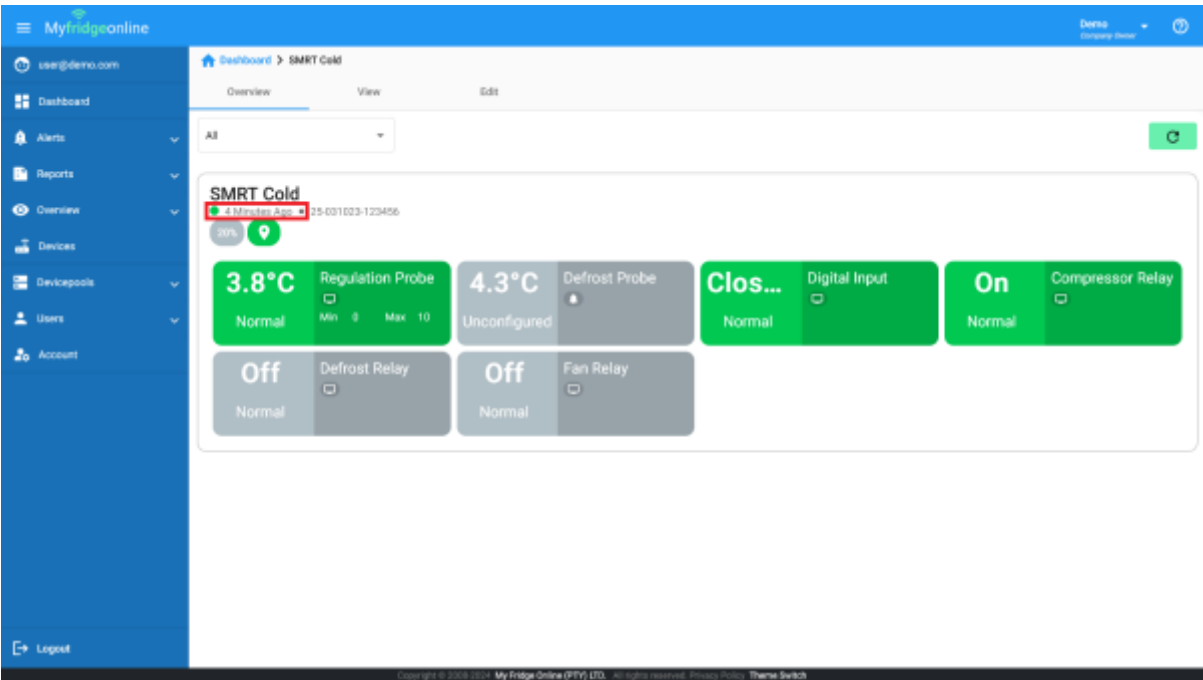


Parameter Information

Parameters are displayed either on chips or cards. Parameter information can be viewed here such as the parameter name, current value of the parameter, the parameter status and alert configuration. Displayed values are dependent on the template selected. The color of the parameter and the message displayed indicates the parameter's status.

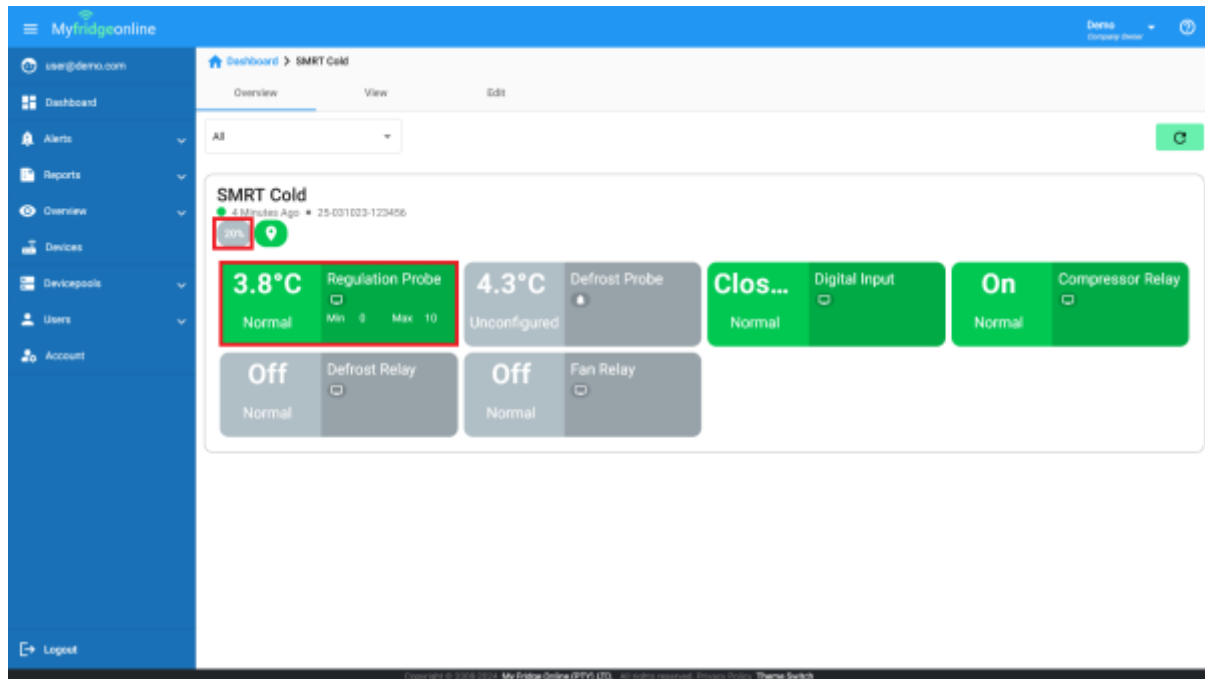


Alert configurations can be viewed here. The bell icon indicates the number of alert groups set, the monitor icon indicates the number of server alerts that are selected and a snooze icon indicates the number of rules that are currently snoozed (this is based on the alert schedule). These are all dependent on the number of rules set on the parameter.

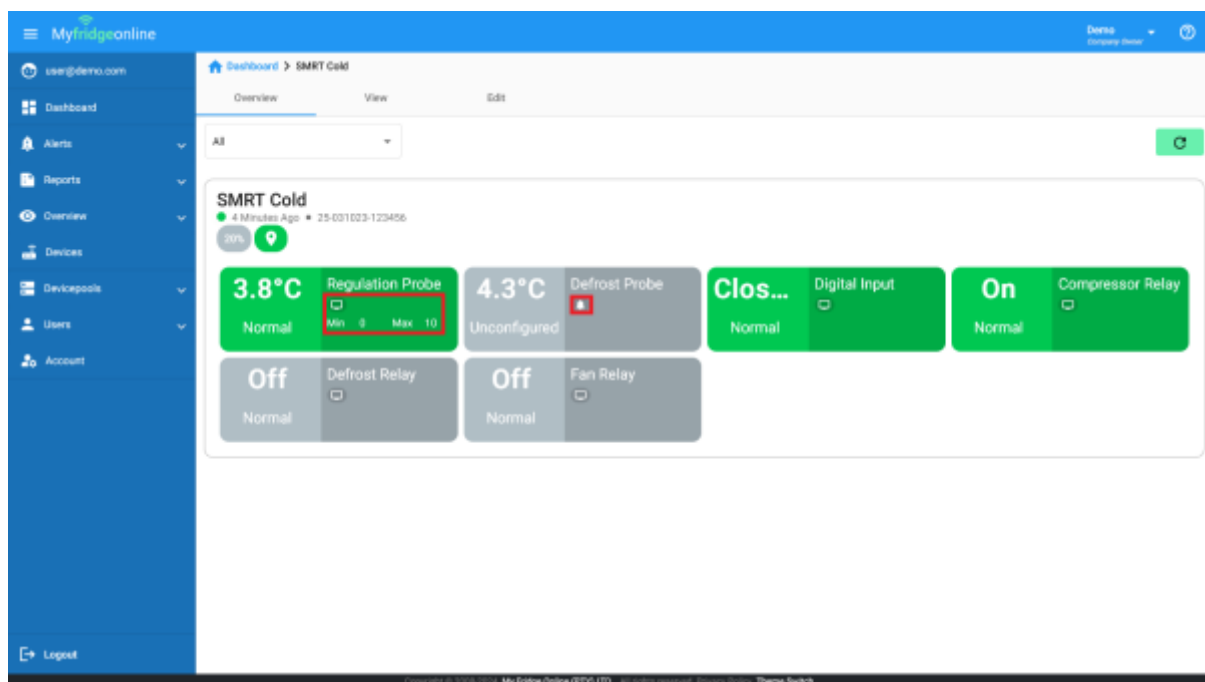

Editing Parameters


Parameters can be selected by clicking on them, the parameter color will change to pink to indicate that it has been selected. Upon selection, a side menu will appear with a number of options (depending on the user role).

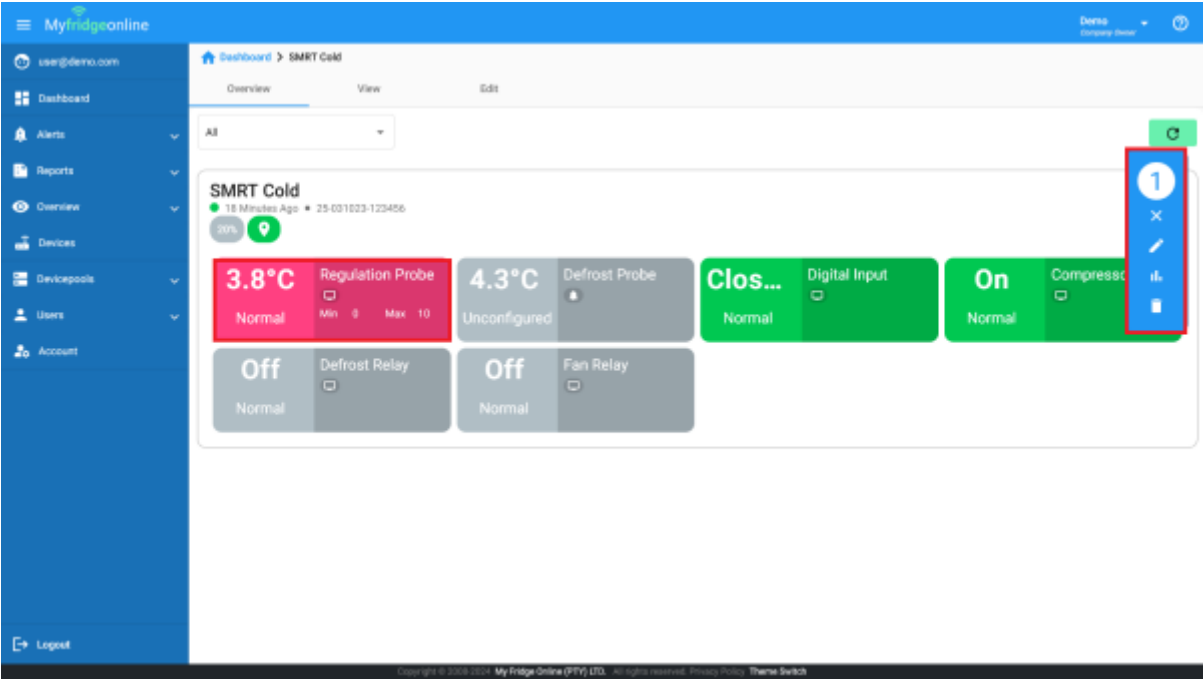


Selecting Cancel will end the selection.



Selecting Edit will open the [Parameter Edit](#) dialog.

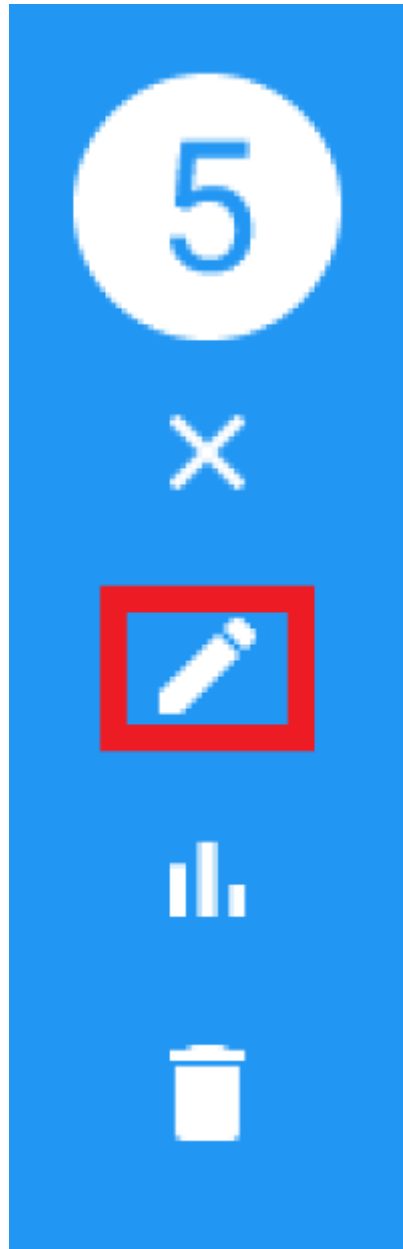

Selecting Graph will open the [Parameter Graph](#) dialog using the current selected parameters information.

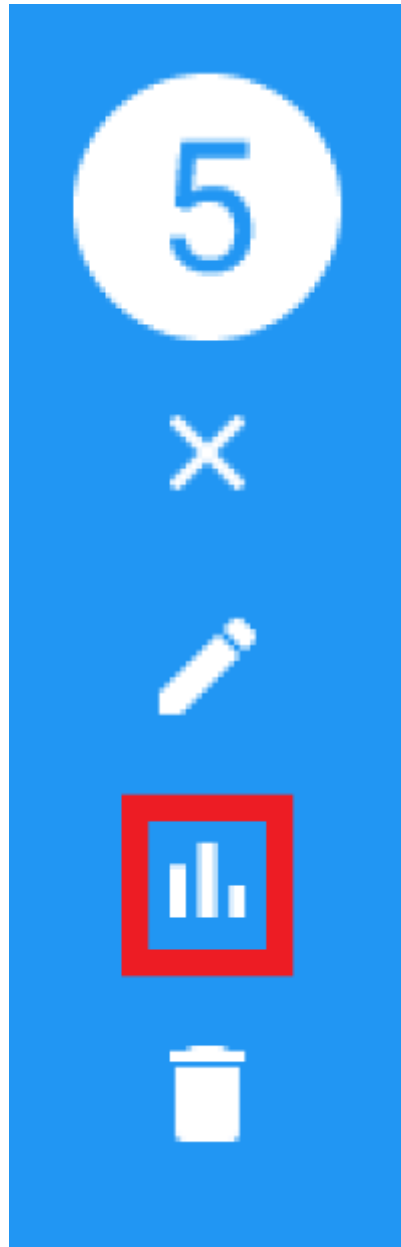


Selecting Delete will delete the selected parameters.




The View Tab

The View tab contains read-only parameters displayed within a table. The table displays read-only parameter values, short code, descriptions and alarm configurations. These are grouped and displayed by parameter type.

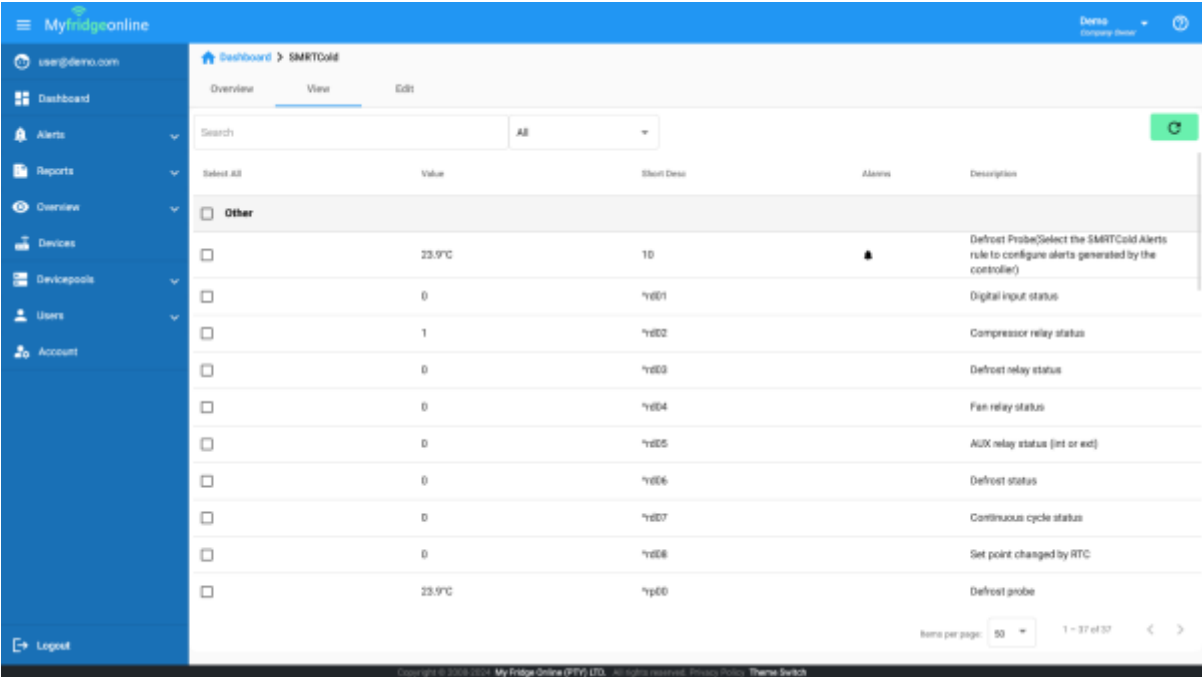

Filtering Parameters

Parameters can be filtered by their category by using the drop down menu. The search function also allows further filtering.

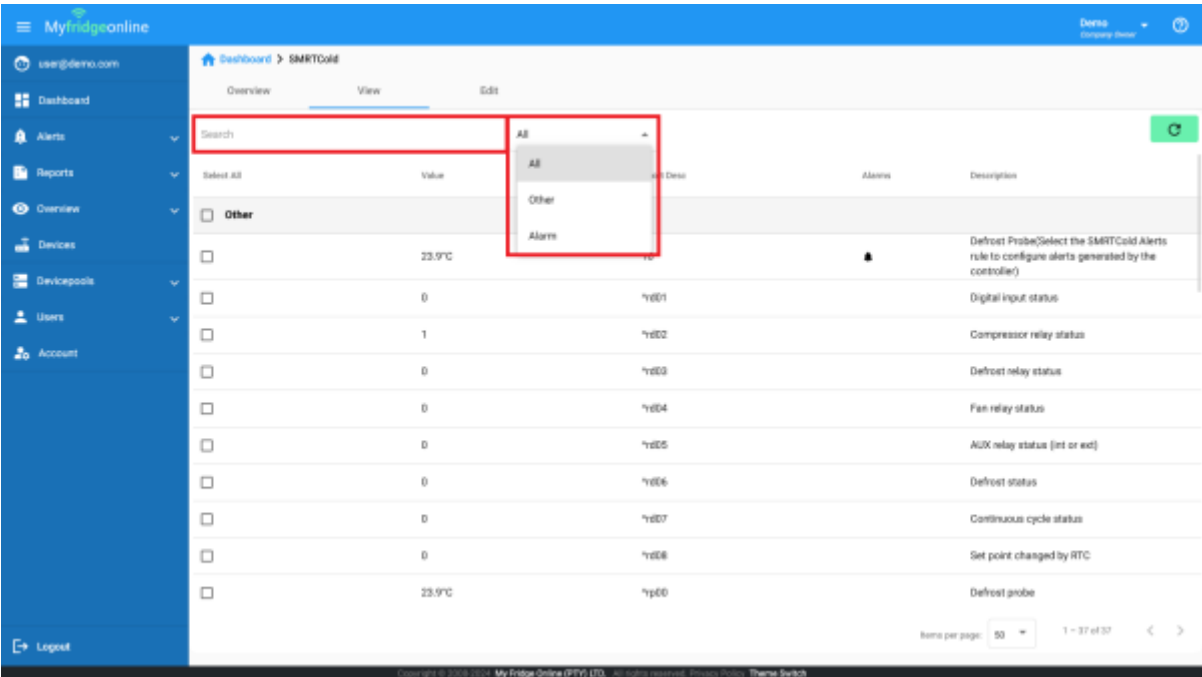

Alarm Configurations

Alert configurations can be viewed here. The bell icon indicates the number of alert groups set, the monitor icon indicates the number of server alerts that are selected and a snooze icon indicates the number of rules that are currently snoozed (this is based on the alert schedule). These are all dependent on the number of rules set on the parameter.

The screenshot shows the 'MyFridgeOnline' dashboard for a 'SMRTCold' device. The 'Alarm' tab is selected, displaying a table with columns: Select All, Value, Short Desc, Alarm, and Description. The 'Alarm' column is highlighted with a red box. The table lists various alarm types with their corresponding values and descriptions.

Select All	Value	Short Desc	Alarm	Description
☐	0	*ah		High temperature alarm
☐	0	*al		Low temperature alarm
☐	0	*ad		Delayed external alarm
☐	0	*adfl		Defrost timeout alarm
☐	0	*ahcn		High condenser temperature alarm
☐	0	*axim		Immediate external alarm
☐	0	*afp01		Probe 1 fault alarm
☐	0	*afp02		Probe 2 fault alarm
☐	0	*afp03		Probe 3 fault alarm
☐	0	*afmc		RTC fault alarm

Editing Parameter Configuration

Parameters can be selected by clicking on the checkbox within the table, or by selecting an entire category. Upon selection, a side menu will appear with a number of options (depending on the user role). The options displayed here are the same as the Overview tab.

The screenshot shows the 'MyFridgeOnline' dashboard with the 'Alarm' category selected in the left sidebar. The 'Alarm' table is displayed, and a side menu is open on the right, showing 14 options. The 'Alarm' category in the sidebar and the side menu are highlighted with red boxes.

Select All	Value	Short Desc	Alarm	Description
☒	0	*ah		High temperature alarm
☒	0	*al		Low temperature alarm
☒	0	*ad		Delayed external alarm
☒	0	*adfl		Defrost timeout alarm
☒	0	*ahcn		High condenser temperature alarm
☒	0	*axim		Immediate external alarm
☒	0	*afp01		Probe 1 fault alarm
☒	0	*afp02		Probe 2 fault alarm
☒	0	*afp03		Probe 3 fault alarm
☒	0	*afmc		RTC fault alarm

Setting Up Board Alerts


This a legacy option is only available on SMRT Cold devices

Alerts determined by the controller can be configured by clicking on the Defrost Probe and selecting

edit from the options menu. Adding the SMRT Cold Board alert rule to the Defrost Probe allows alerts to be dispatched from the server when one or more controller alarms are triggered.

To configure this rule follow the following steps:

- 1. Select the defrost probe from the parameter table.

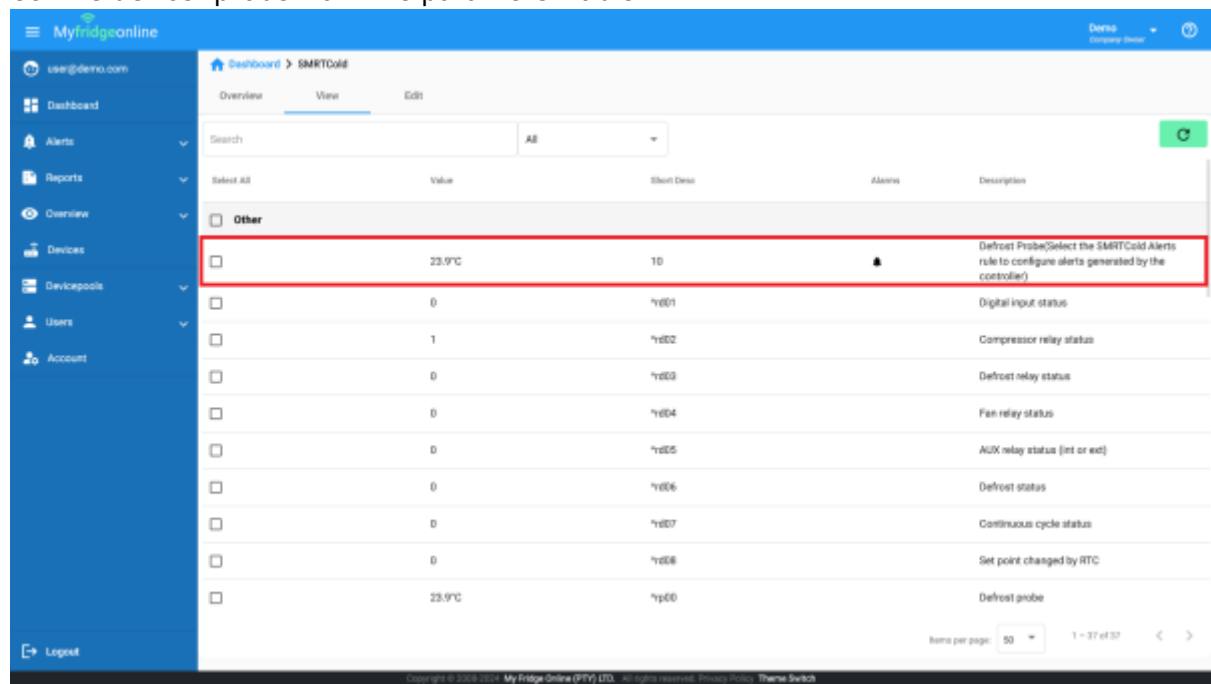

- 2. Click the plus button and select the rule named SMRTCold Alerts.

Edit

Details

Rules

Attributes

Rules

Rules



Add New Rule

Rule

Setpoint

SMRTCold Alerts

Cancel

Submit

3. Configure the alert by adding a delay. Delays determine the duration at which the value remain above or below the given configuration before an alert is dispatched.

Edit

Details

Rules

Attributes

Name *

SMRTCold Alerts

Delay *

0

The delay in minutes before escalation begins

Alert group

Template

Default

Configuration

☒ Enable HHL☐ Enable MinMax

Low Low

Cancel

Submit

4. Select an alert group.

MyFridgeOnline - <https://docs.myfridgeonline.com/>

Edit

DetailsRulesAttributes

Name *
SMRTCold Alerts

Delay *
0
The delay in minutes before escalation begins

Alert group

Template
Default

Configuration

☒ Enable HHL☐ Enable MinMax

Low Low

Cancel

Submit

5. After you are done click save.

Edit

Details

Rules

Attributes

Configuration

☒ Enable HHL ☐ Enable MinMax

Low Low

0

High High

10

Alert Type

Board Alert

☐ Back In Range Alert☐ Enable Alert Schedules

Cancel

Save

Cancel

Submit

6. The rule should then appear in the list. Click the submit button to finalize your update.

Edit

DetailsRulesAttributes

Rules

Rules

×

SMRTCold Alerts

+


Cancel

Submit

Alerts will now be dispatched to the users in the alert group when the controller's alarms are triggered.


The Edit Tab

The Edit Tab contains contains editable parameters displayed within a table. The table displays editable parameter values, short code and descriptions. These are grouped and displayed by parameter type.

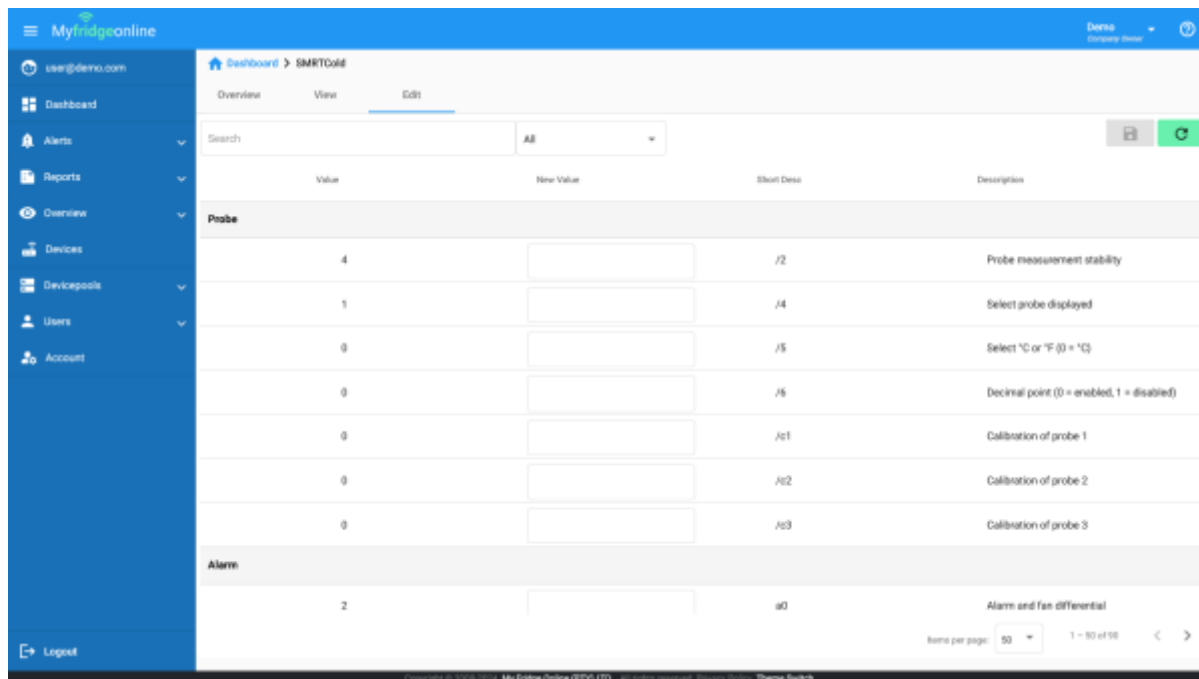


Filtering Parameters

Parameters can be filtered by their category by using the drop down menu. The search function also allows further filtering.

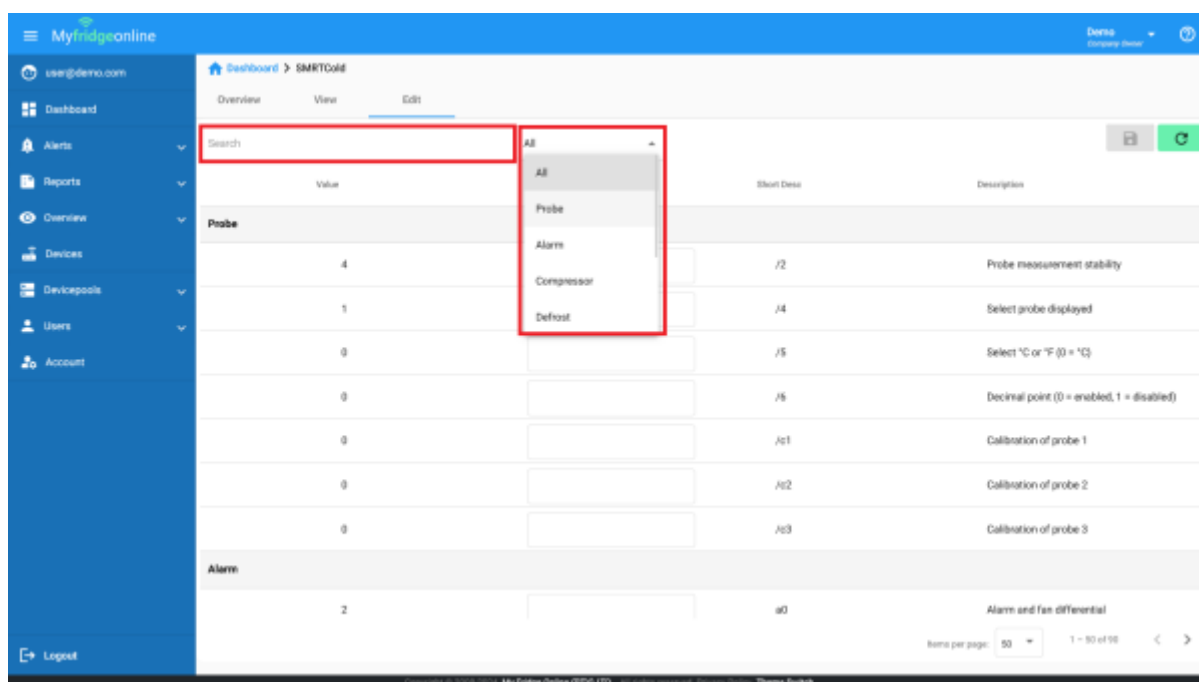

Editing Parameter Values

Entering a value into the 'New Value' field will allow you to assign a new value to the parameter. Doing so will also highlight the field in green if it is a valid value. The save button will allow you to save this value once complete. Multiple fields can be edited simultaneously. Once complete, click the Save button on the right side of the screen, to save your changes.

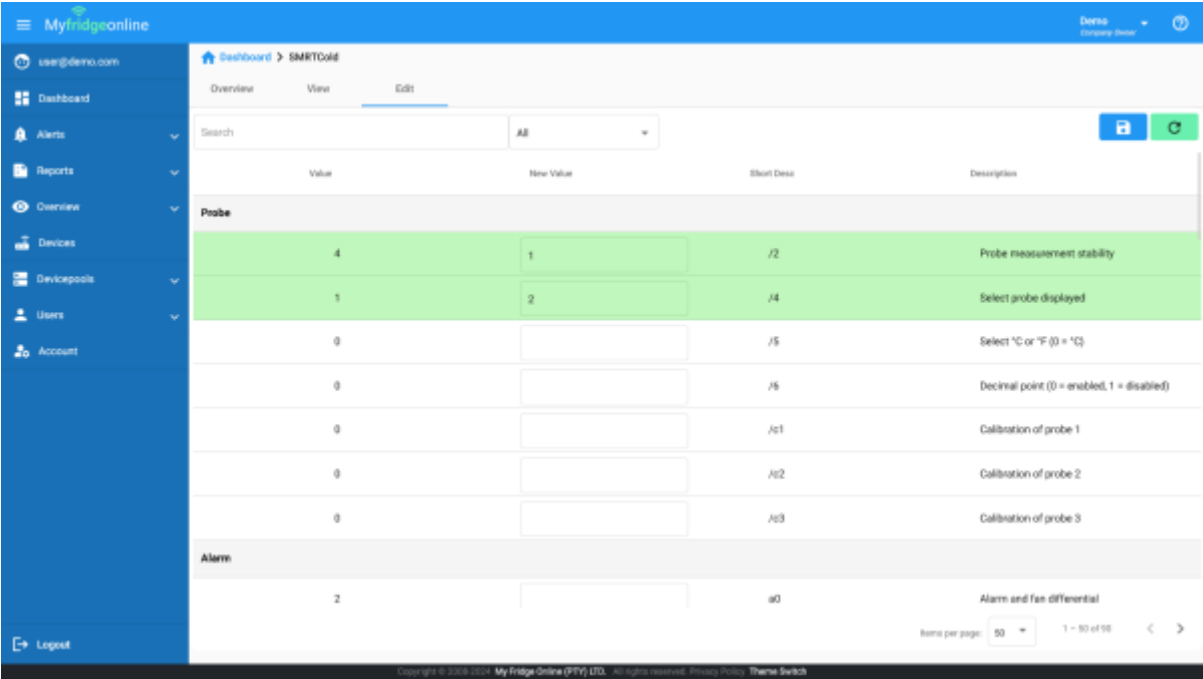

Troubleshooting

On both the View and Edit tab, the following error messages may sometimes appear:

- Value not found 
 - This indicates that a value for the current parameter has not been communicated to the server. This can be avoided by ensuring the device syncs to the server during the first uplink.
- Profile incompatible 
 - This indicates the current profile configuration does not match the device type. This will lead to incorrect data being stored and displayed.
 - This can be fixed by clicking on the error icon. A dialog will appear displaying a list of profiles compatible with your device.
 - Select a valid profile and click 'Submit'.
 - Your device will then be updated to the correct configuration. To ensure all values are received by the server, it is recommended to power cycle the device.

From:
<https://docs.myfridgeonline.com/> - MyFridgeOnline

Permanent link:
https://docs.myfridgeonline.com/doku.php?id=user_manual:dashboard:configure_parameters

Last update: 2024/09/10 09:47

