

IJS

1. Install Carel Applica

Download and install the [Carel Applica](#)

2. Connect To Your Controller

- Open the app and connect to your Carel controller using **Bluetooth** or **NFC** (depending on model).
- You may need to select the account/profile **Service**
- When prompted for a password input **22**

3. Access the Parameters

- Open the main menu.
- Navigate to the **Parameters** section.

< iJW02-iJ


1

Enter parameter/description

/2	Analyse probe measurement stability	5
/3	Display probe value	0
/4	Virtual probe composition	0 %
/5	Unit of measure	°C
/6	Display decimal point	Visible
/cA	Outlet temperature probe calibration	0.0 °C
/cb	Defrost temperature probe calibration	0.0 °C
/cc	Intake temperature probe calibration	0.0 °C
/cF	Auxiliary evaporator defrost temperature probe ...	0.0 °C
/cg	Auxiliary temperature probe 1 calibration	0.0 °C
/cH	Auxiliary temperature probe 2 calibration	0.0 °C


4. Selecting Communication Settings

On the search bar tap the filter icon and then select **Communication**

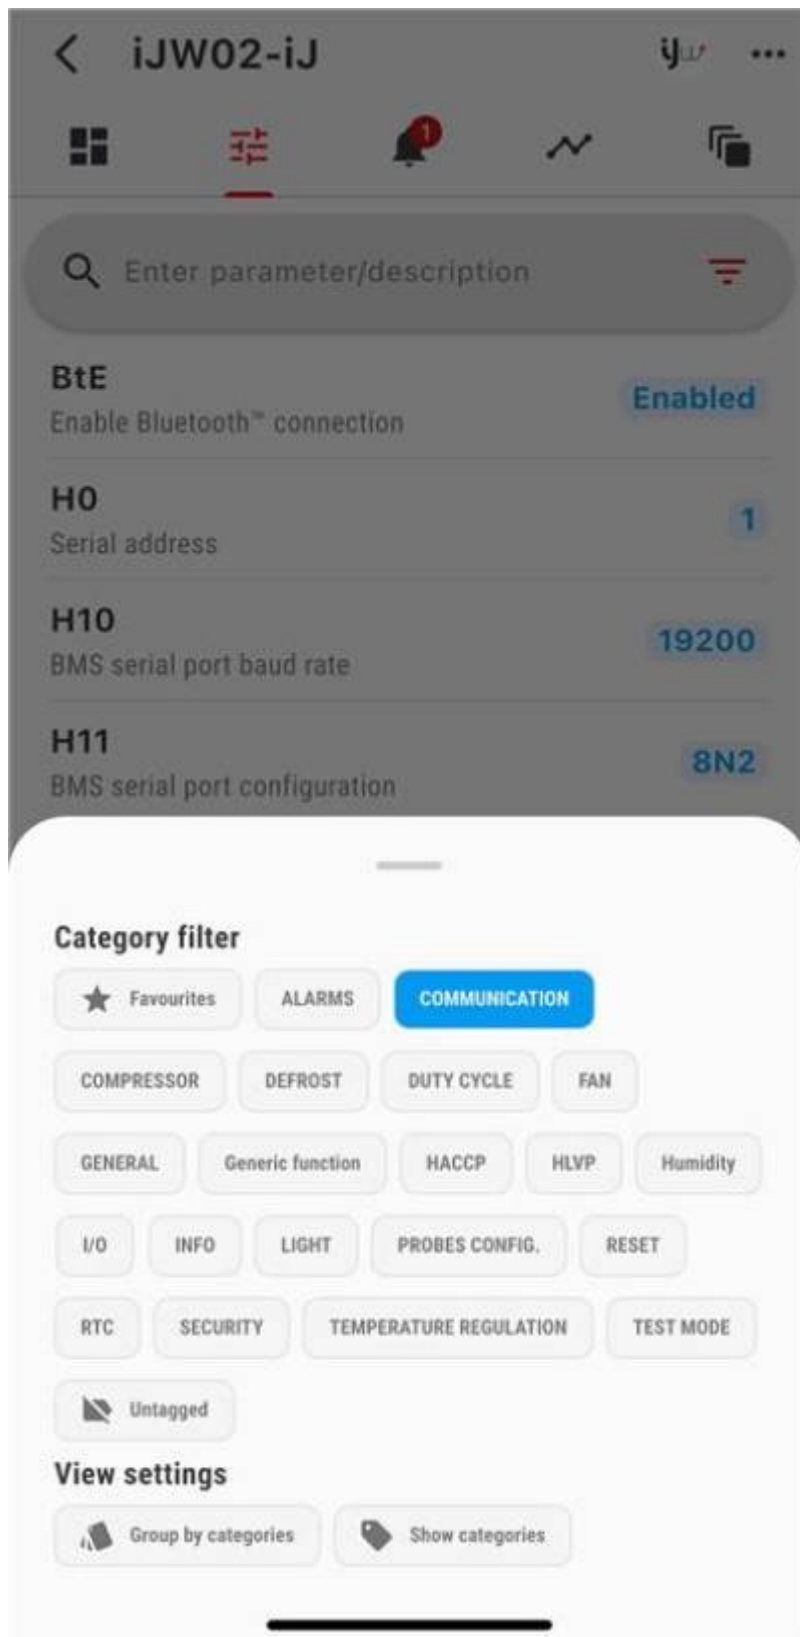


5. Set Communication Parameters


- H0 Serial Address: 1

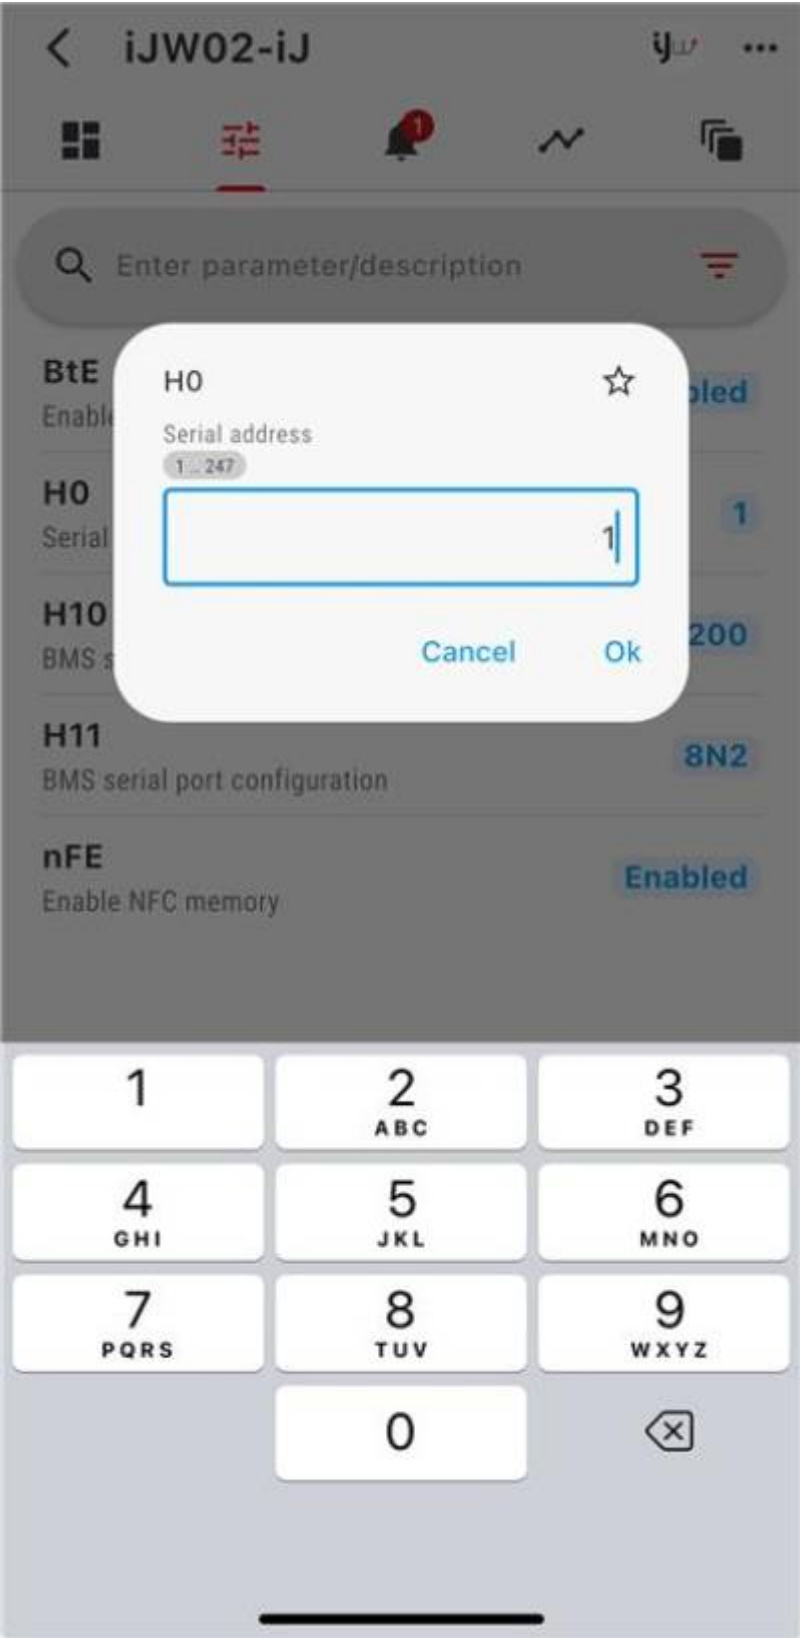

- H10 BMS serial port baud rate: 19200

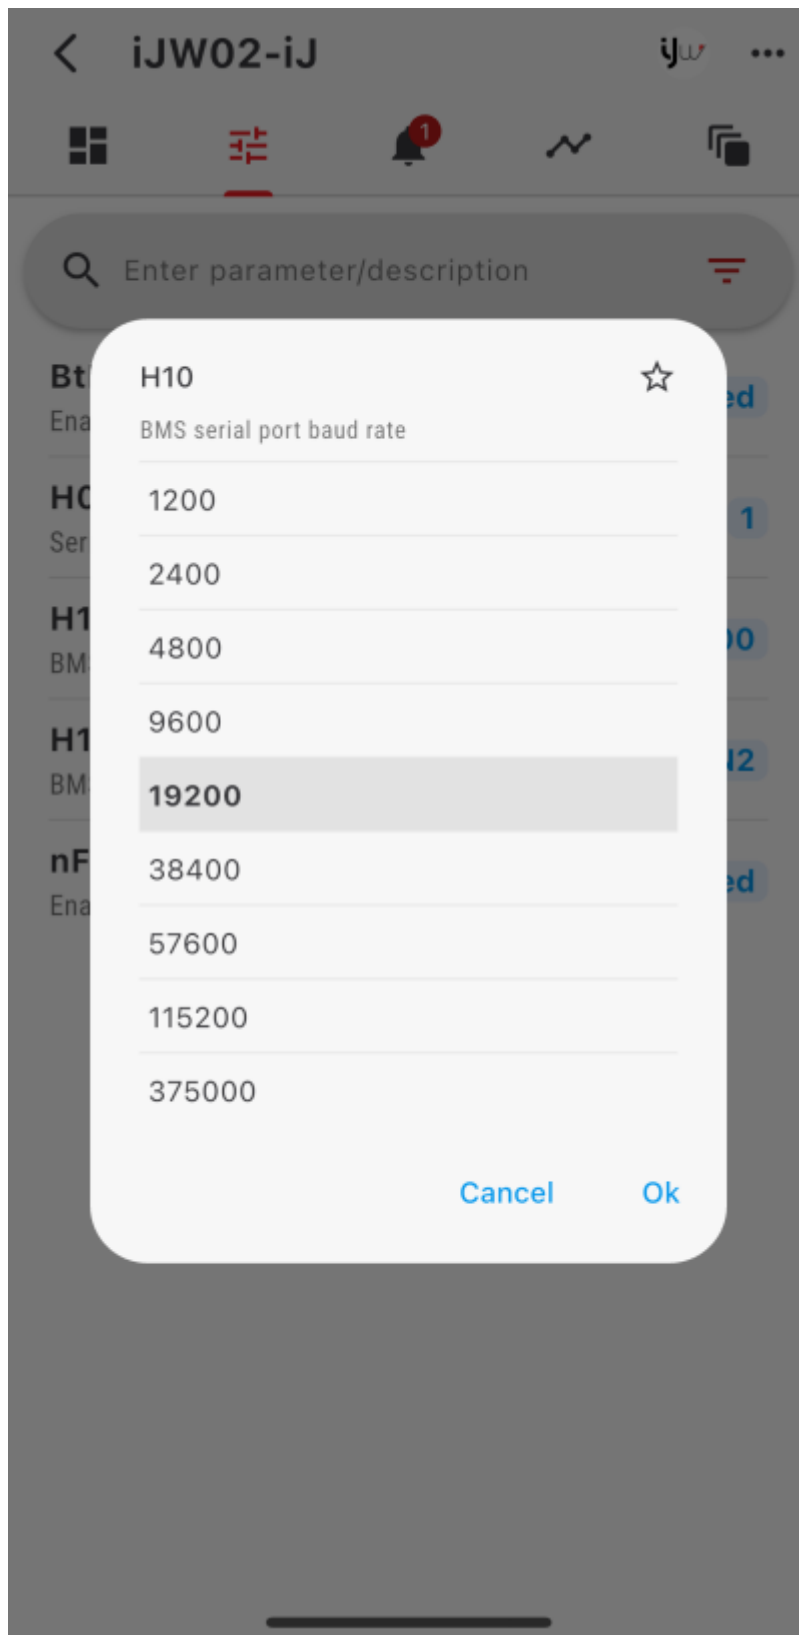

- H11 BMS serial port configuration: 8N2

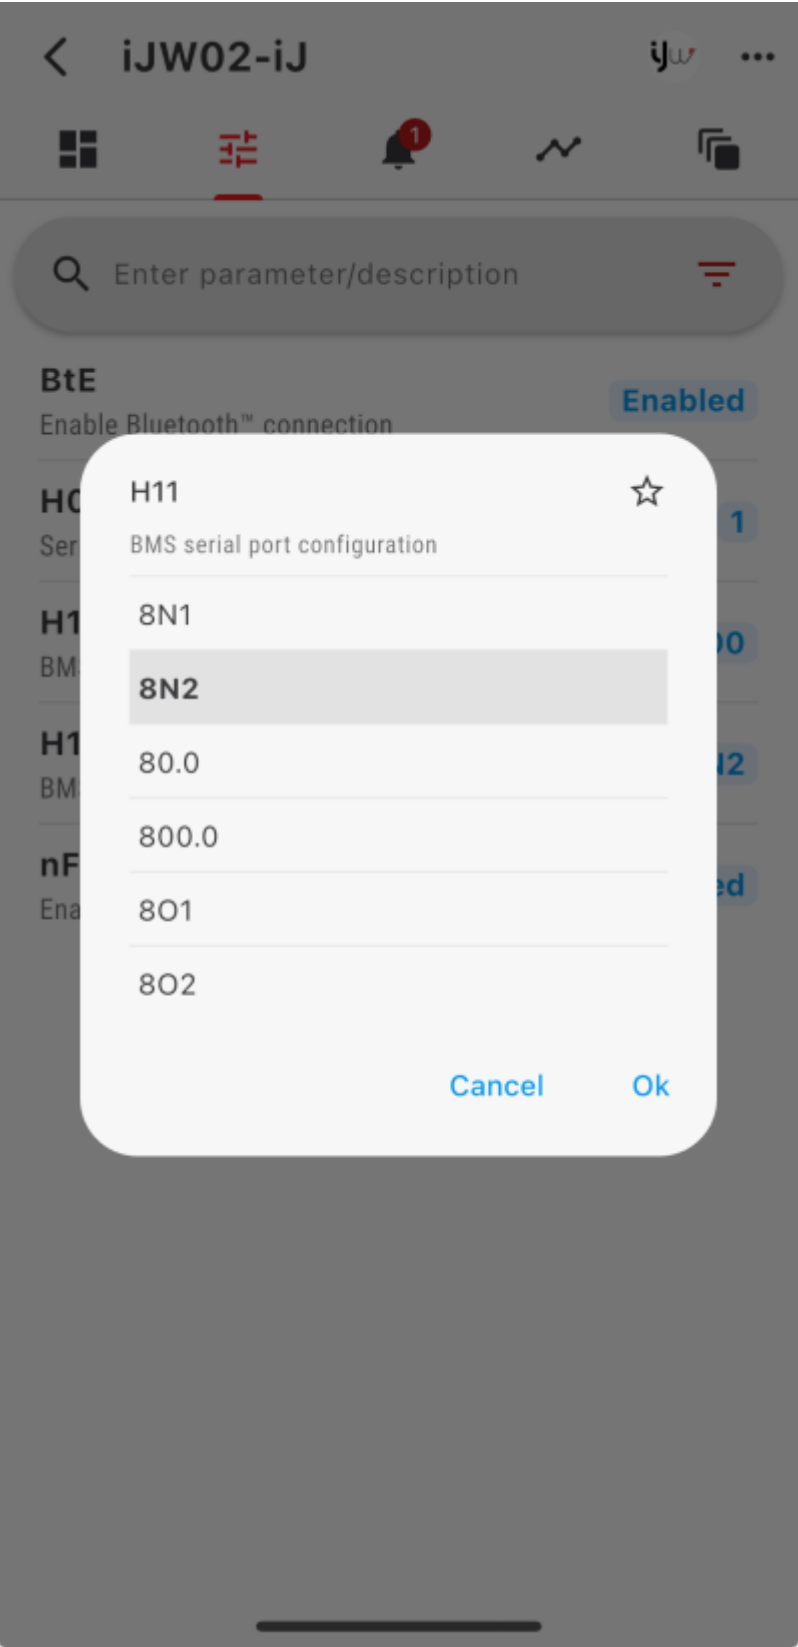

From:
<https://docs.myfridgeonline.com/> - MyFridgeOnline

Permanent link:
https://docs.myfridgeonline.com/products/smrtcold/smrt_cold_mk2/ijs

Last update: 2025/08/26 07:00



